


PEDESTAL JUNCTION CABINET (PJC)

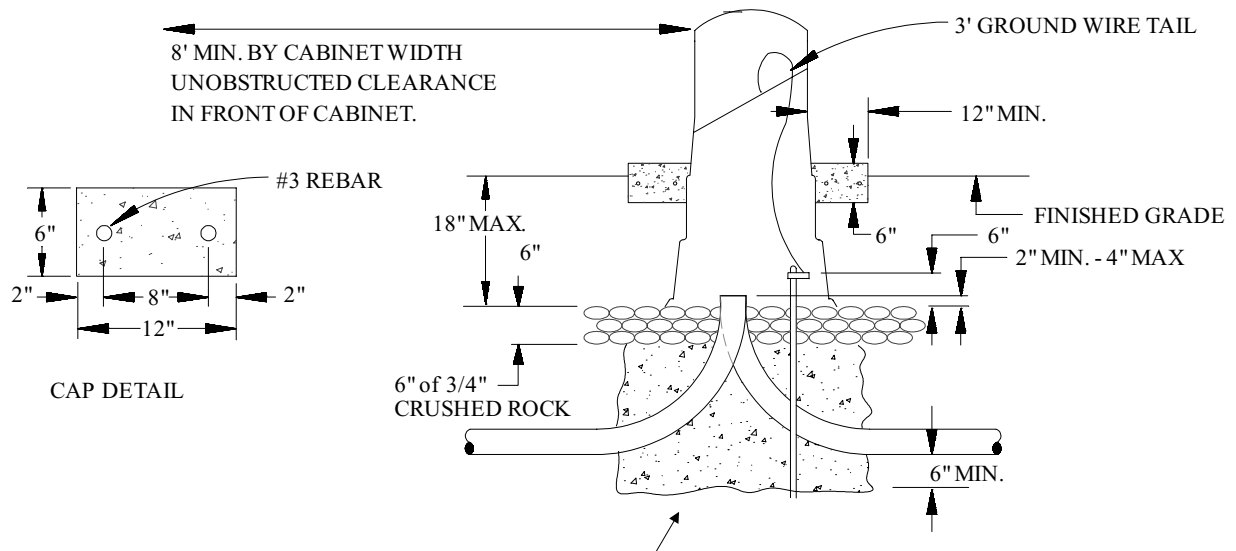

Notes:

1. Conduits to be aligned in a row per Department Inspector's direction.
2. Ground bond wire per UGS-621.1, 722, or 723.
3. PJC is provided by the Department and installed by the Developer.
4. Conduit sweeps shall be encased with concrete (in accordance with UGS-100.1)
5. A minimum 12" concrete cap shall be installed, (in accordance with UGS-015 mix 4001), by the developer around the PJC. See detail above.
6. No telecommunication conduit is to be installed in the PJC.
7. Barrier posts may be required at the discretion of the Department Inspector.
8. For Typical PJC locations, see UGS-730.

PEDESTAL JUNCTION CABINET ONE PIECE FIBERGLASS

UGS


DATE: 2/26/03

REVISION: Added PJC Dimensions

DATE: 2/28/03

APPROVAL: *Dave Redding*

PEDESTAL JUNCTION CABINET DIMENSIONS

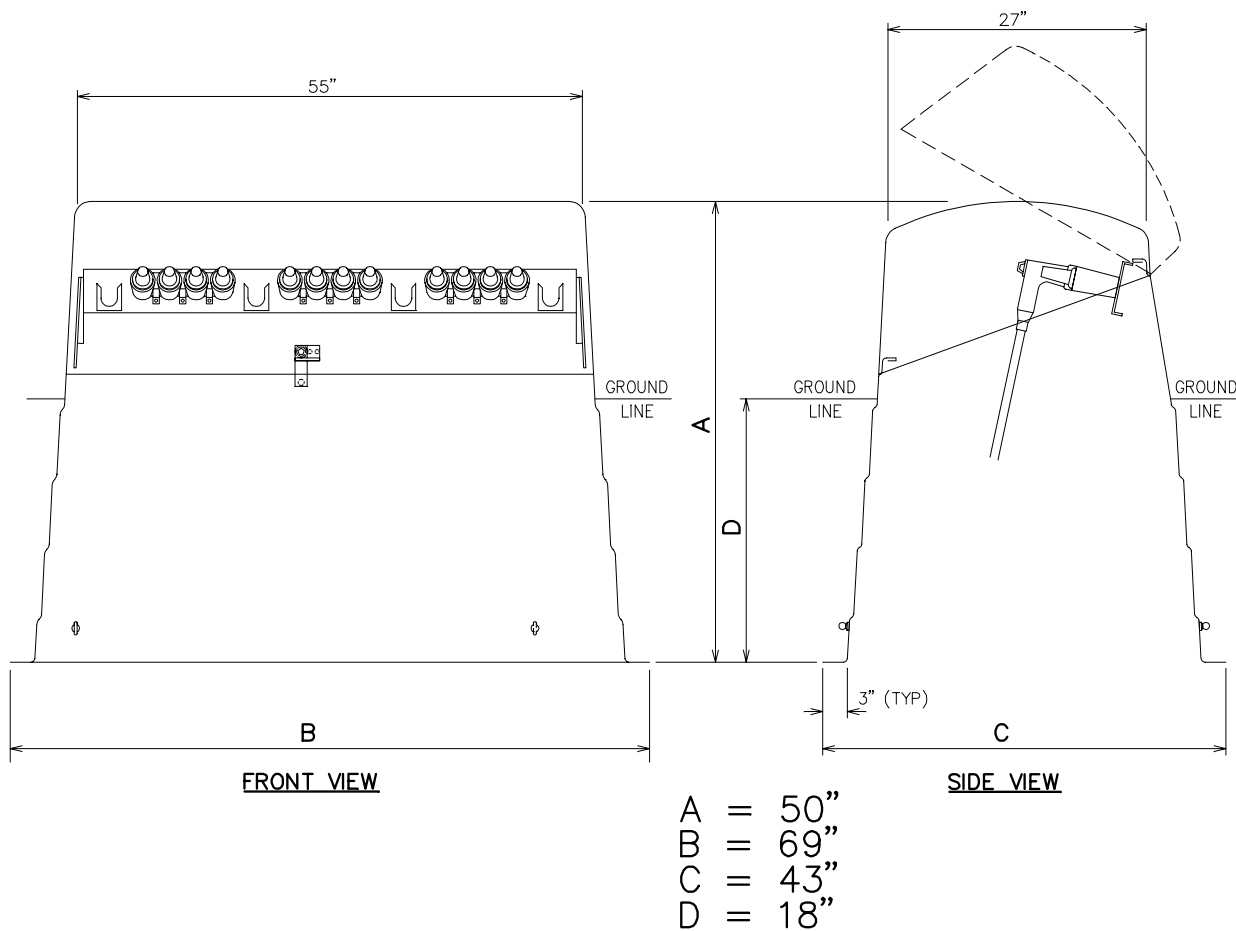

Notes:

1. Small dimension variations have been allowed for in the different manufacturers.